


# HAM INTERNATIONAL MULTIMODE 3

## Schematic Diagram

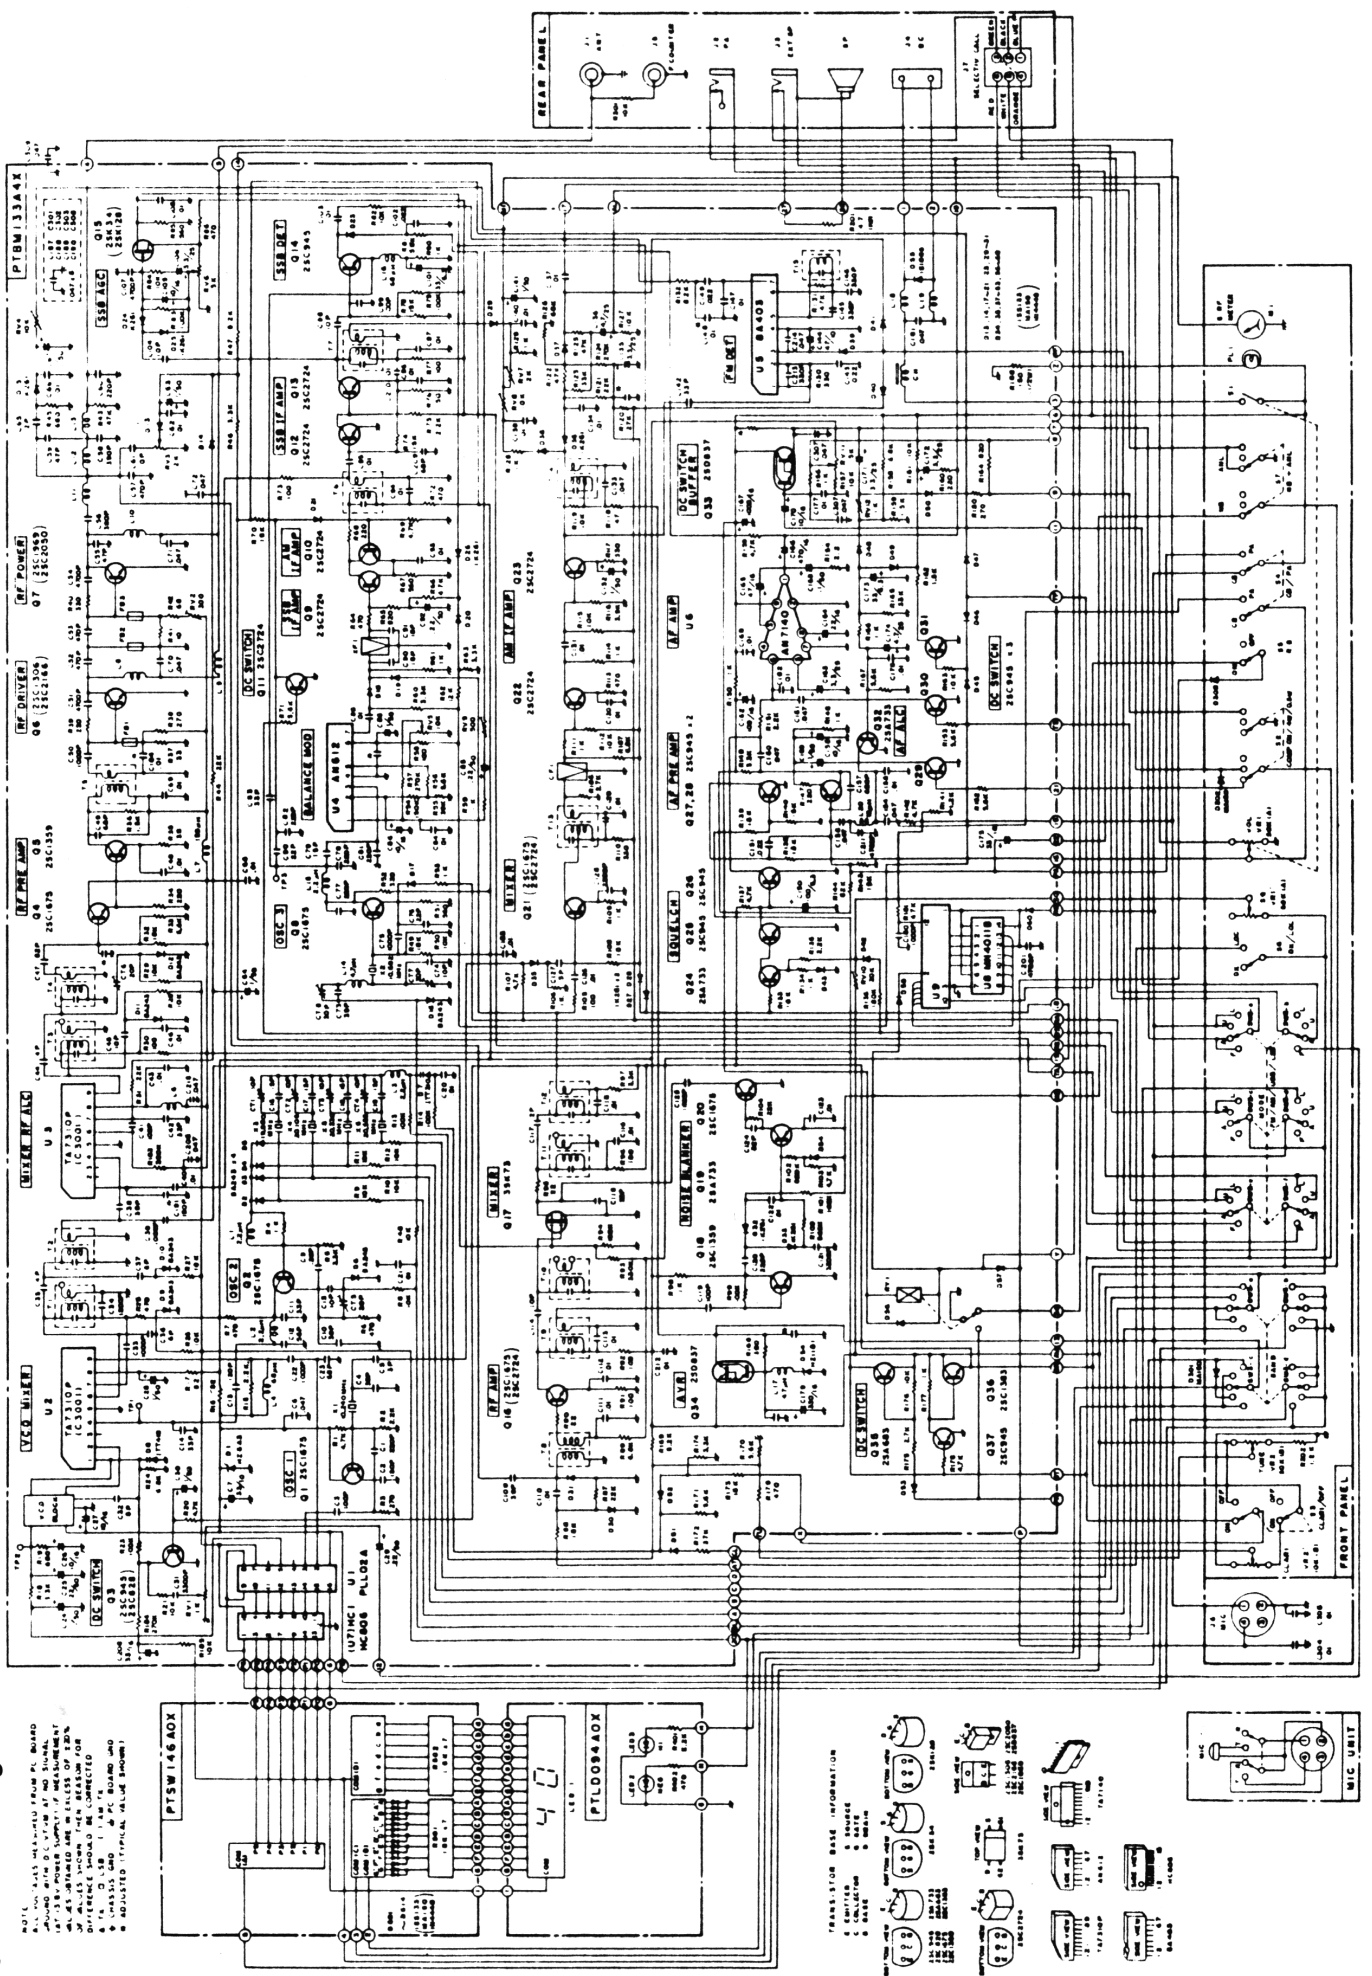

NOTE:  
 1. ALL VOLTAGE MEASUREMENTS SHOULD BE MADE AT 100% POWER OUTPUT OF MEASUREMENT POINT UNLESS OTHERWISE SPECIFIED.  
 2. ALL VOLTAGE MEASUREMENTS SHOULD BE MADE WITH THE MEASUREMENT POINTS CONNECTED TO THE LOAD.  
 3. ALL VOLTAGE MEASUREMENTS SHOULD BE MADE WITH THE MEASUREMENT POINTS CONNECTED TO THE LOAD.  
 4. ALL VOLTAGE MEASUREMENTS SHOULD BE MADE WITH THE MEASUREMENT POINTS CONNECTED TO THE LOAD.  
 5. ALL VOLTAGE MEASUREMENTS SHOULD BE MADE WITH THE MEASUREMENT POINTS CONNECTED TO THE LOAD.

- PARTS LIST BASE INFORMATION
- 1. RESISTOR
  - 2. CAPACITOR
  - 3. VACUUM TUBE
  - 4. SWITCH
  - 5. POTENTIOMETER
  - 6. TRANSFORMER
  - 7. COIL
  - 8. INDUCTOR
  - 9. DIODE
  - 10. TRIODE
  - 11. TETRODE
  - 12. PENTODE
  - 13. HEATER
  - 14. GRID
  - 15. SCREEN
  - 16. CONTROL
  - 17. ANODE
  - 18. CATHODE
  - 19. BASE
  - 20. GRID
  - 21. SCREEN
  - 22. CONTROL
  - 23. ANODE
  - 24. CATHODE
  - 25. BASE
  - 26. GRID
  - 27. SCREEN
  - 28. CONTROL
  - 29. ANODE
  - 30. CATHODE
  - 31. BASE
  - 32. GRID
  - 33. SCREEN
  - 34. CONTROL
  - 35. ANODE
  - 36. CATHODE
  - 37. BASE
  - 38. GRID
  - 39. SCREEN
  - 40. CONTROL
  - 41. ANODE
  - 42. CATHODE
  - 43. BASE
  - 44. GRID
  - 45. SCREEN
  - 46. CONTROL
  - 47. ANODE
  - 48. CATHODE
  - 49. BASE
  - 50. GRID
  - 51. SCREEN
  - 52. CONTROL
  - 53. ANODE
  - 54. CATHODE
  - 55. BASE
  - 56. GRID
  - 57. SCREEN
  - 58. CONTROL
  - 59. ANODE
  - 60. CATHODE
  - 61. BASE
  - 62. GRID
  - 63. SCREEN
  - 64. CONTROL
  - 65. ANODE
  - 66. CATHODE
  - 67. BASE
  - 68. GRID
  - 69. SCREEN
  - 70. CONTROL
  - 71. ANODE
  - 72. CATHODE
  - 73. BASE
  - 74. GRID
  - 75. SCREEN
  - 76. CONTROL
  - 77. ANODE
  - 78. CATHODE
  - 79. BASE
  - 80. GRID
  - 81. SCREEN
  - 82. CONTROL
  - 83. ANODE
  - 84. CATHODE
  - 85. BASE
  - 86. GRID
  - 87. SCREEN
  - 88. CONTROL
  - 89. ANODE
  - 90. CATHODE
  - 91. BASE
  - 92. GRID
  - 93. SCREEN
  - 94. CONTROL
  - 95. ANODE
  - 96. CATHODE
  - 97. BASE
  - 98. GRID
  - 99. SCREEN
  - 100. CONTROL